



# AURANGABAD MUNICIPAL CORPORATION

FIRE BRIGADE

TELEPHONE NO-2334000-40 FAX No-2331444

Outward No:AMC/FIRE / 764 /2021

Date 26/ 10/2021

To,  
Principal,  
Shri. Rahul Mohanpurkar,  
S.B.E.S. Centenary School,  
S.B. Campus, Opp Citibank,  
Nirala Bazar Road, Aurangapura,  
Aurangabad.

Sub;- Provisional Fire NOC is issued to the Principal, Shri. Rahul Mohanpurkar, S.B.E.S. Centenary School, S.B. Campus, Opp Citibank, Nirala Bazar Road, Aurangapura, Aurangabad.

Ref:- 1) Your letter dated 17/10/2021

2) CFO Inspection on dated 26/10/2021

With Reference to the above subject Provisional Fire NOC is issued to the Principal, Shri. Rahul Mohanpurkar, S.B.E.S. Centenary School, S.B. Campus, Opp Citibank, Nirala Bazar Road, Aurangapura, Aurangabad. Plot area 35498.40 Sq. mtr.

Owner has paid Renwaled fees Rs 25000/- & Provisional Fire Noc Fees Rs 10000/- Total Rs. 35,000/- in Fire brigade Receipt No.20506 dated on 23/10/2021.

Sr. No	Name of Building	Height (Meter)	Building No.	No of floors	Area of Plot (Sq. Mtr)	Built up area (Sq. Mtr)	Fire Fund	Noc Fees
1	S.B.E.S. Centenary School Building	11.40 mtr.	1	B+G + 2 Floors	35498.40 Sq. mtr	641.89 Sq. Mtr.	25000	10000

Following Fire prevention and Fire protection & Fire Fighting measures subject to the is S.B.E.S. Centenary School Building shall be provided.

1. Open space all around the building shall be provided for the movement of fire tender and which will carry 25 tons. weight capacity.
2. Overhead water tank 20000 lit capacity with the Booster pump of suitable capacity for building Shall be provided.
3. Fire service inlet 2 way incoming shall be provided.
4. Yard Hydrant points all around the building with fire hose pipe/ branch shall be provided.
5. Down Commer having outlet on all floors with hose pipe / branch shall be provided.
6. Hose reel of 100 feet on all outlets shall be provided.
7. Fire Extinguisher of / Co2/ ABC / Foam Fire Extinguisher Fire Buckets of suitable capacity / quantity shall be provided.
8. Main Staircase of Width Minimum 2.00 mtr each flight width & fire Escape staircase of minimum width 2.00 mtr each flight width to be provided. The travel distance from the any part of the hotel rooms should be maintained as per thr rules.
9. Use of all Pipes of TATA Zenith or APL (APPOLO) or ISI Mark for Fire Down comer system shall be Provided
- 10 All the above requirements shall be carried out with prior approval from fire Brigade.

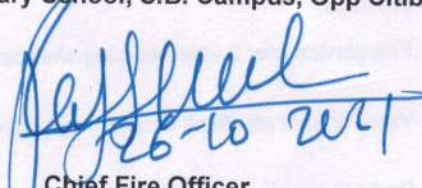
NOC



The Fire Fighting System arrangements installed for Existing area, such as Hydrant System, Hose Reel Hose, Fire Extinguishers should be extended to the proposed construction and also integrated with the existing system.

Sr. No.	Fire Fighting Installation	Requirements	Provision	Remarks
1	Portable Fire Extinguishers	Required	IS: 15683 & IS: 2190	Portable Fire Extinguisher should be installed Confirming to IS 15683 & Other I.S Codes
2	Hose Reel	Required Prominent Places	At Varous Strategic Locations	On each floor in the Staircase landing for fire fighting. The first aid hose reel shall be connected directly to riser/Down comer main and diameter of the hose reel shall not be less than 19 mm Confirming to IS 884:1985
3	Manually Operated Fire Alarm System	Required on Fire Act 2007	At every Floor on strategic location	
4	Booster Pump	Existing Pumps shall be Provided	Fire Fighting pumps shall be well maintained.	
5	Sign Indicators for all Fire Safety Safe evacuation of occupants in case of emergency signs	Required at Prominent Places in all building	Sign Indicators should provided at prominent places as per the guidelines given in IS 9457 for Safety colour and safety IS: 12349 For Fire Protection Safety Signs IS: 12407 for Graphics symbots for Fire Protection Plan.	
6	Fire Brigade Connection	Required on Fire Water Tank	For Static Water Tank and For Hydrant System.	

As per BPMC ACT -1949 section 376, Development control Rules of 1983 and Maharashtra Fire prevention & Life safety Measures Act 2006 reference to above subject **Provisional Fire NOC is issued to the Principal, Shri. Rahul Mohanpurkar, S.B.E.S. Centenary School, S.B. Campus, Opp Citibank, Nirala Bazar Road, Aurangapura, Aurangabad.**

  
**Chief Fire Officer**  
**Fire Brigade**  
**Municipal Corporation Aurangabad**

Copy to:- A D.T.P AMC, Aurangabad.